
Fire Detection Alarm System, CCTV & Structured Cabling


Scale 1:100




Level 1

Scale 1:100

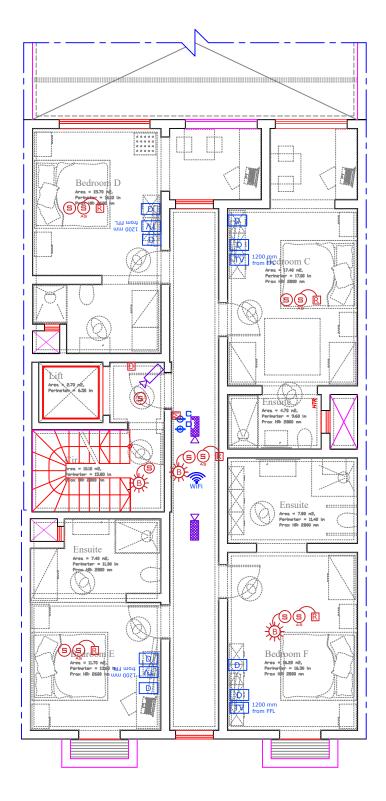

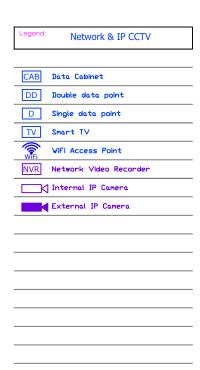

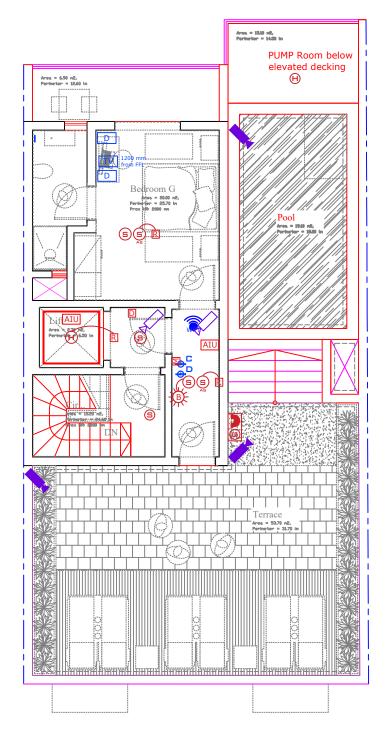

Level 2

Scale 1:100



NOTES:

This drawing is to be read in conjunction with all other relevant drawings.

All Power/ lighting/ ELV layouts are to be rechecked and approved by the engineer in charge of the project.

Any discrepancies shall be brought forward to the attention of the designer in charge of the project immediately.

The contractor shall be responsible for taking detailed measurements for every individual job which shall be checked on site proir to any work commencing.

All dimensions shown on this drawing are only indicative/1 and shall NOT be used for manufucturing purposed unless noted otherwise.

This drawing is to be printed on A3 standard paper.
Actual size printing command is to be used in order to retain scale.

 $\label{eq:All dimensions} \mbox{ are in millimeters.}$

COPY

title job description Designed & Drawn By: Client scale date drawing
Proposed Planning ELV Layouts G&M Debattista 1:100 18/7/2020